


DOUBLE OR TRIPLE POLE CIRCUIT  
BREAKER REQUIRED WITHIN TEN FEET  
OF SHORE INLET BETWEEN AC SOURCE  
SELECTOR SWITCH AND SHORE POWER

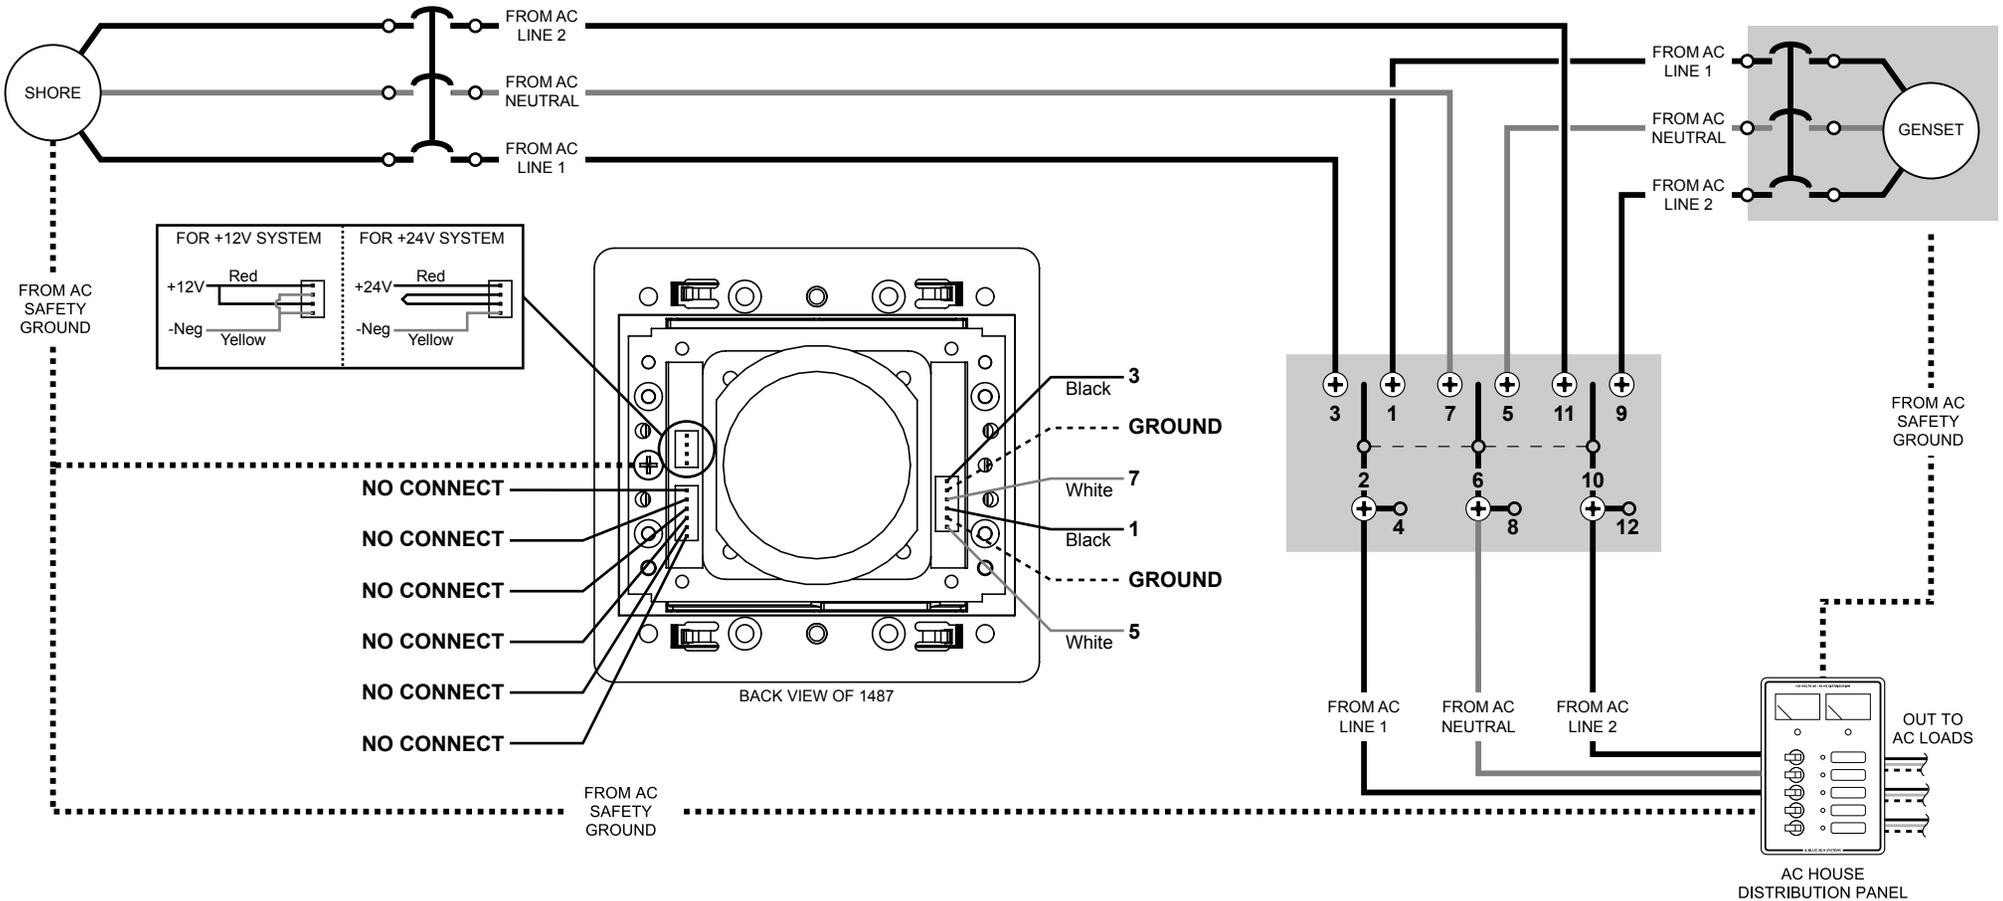

**Warning: Do not cut out resistors in wire harness.**

Note: Do not confuse the white neutral current carrying wires, sometimes called "ground", with the green non-current carrying wires, sometimes call grounding. These two wires must only be connected at the source of power, nowhere else.

Please refer to the 360 Panel System Installation Manual for additional installation information.

Panel Part Number	Switch Part Number	L	
		Inches	Millimeters
1481, 1482, 1484, 1485, 1489	9009, 9010, 6337	0.35	9
1480, 1483, 1486, 1487, 1488	9011, 9019, 9077, 9093	0.60	15



Wire Strip Length